

## System Stop Box

593080 – Control Box, System Stop



Hydro-Chem, Inc.  
6605 Broadmoor Ave SE  
Caledonia, MI 49316

Office: (616) 531-6420  
e-mail: [service@hcs-clean.com](mailto:service@hcs-clean.com)

<b>Control Voltage</b>	24VAC/VDC
<b>Approx. Dimensions</b>	3.75"W x 6"H x 3.875"D

### General Info

The purpose of this manual is to provide the necessary information to install and operate the Hydro-Chem equipment to exceed your defined expectation.

The System Stop boxes will come assembled ready for wiring. Contractor wiring specs may be found within the document holder of the MCP.

## System Overview

Figure 1 outlines the overall layout of the System Stop Box.

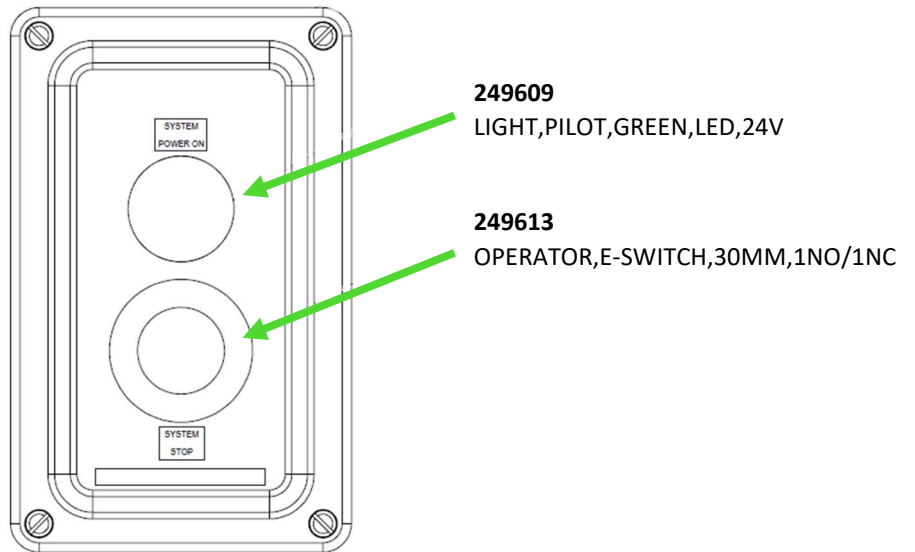


Figure 1. System Stop Box Layout

## Installation & Set-Up

The enclosure of this assembly is to be mounted to the wall at an accessible location in the wash bay per the project MEP. The wiring instructions are found within the Electrical Packet for the system.

## Troubleshooting

Issue	Potential Solution
No Outputs are Turning On	Pull the System Stop buttons. If not pushed in - check the Solid-State relay and if the light isn't on, check that the system stop circuit is closed (all through the yellow terminals and N/C circuits on each System Stop button)
Green Power Light Isn't On	